



***Feasibility Study  
For  
Generation Interconnection  
Request  
GEN-2007-043***

SPP Tariff Studies  
(#GEN-2007-043)

April, 2008

## **Executive Summary**

<OMITTED TEXT> (Customer) has requested a Feasibility Study for the purpose of interconnecting 300 MW of wind generation within the control area of Oklahoma Gas and Electric (OKGE) located in Grady County, Oklahoma. The proposed interconnection point is on the existing Lawton Eastside (American Electric Power West-AEPW) – Cimarron (OKGE) 345 kV transmission line, on the portion owned by OKGE. The proposed in-service date is December 1, 2009.

Power flow analysis has indicated that for the powerflow cases studied, it is possible to interconnect the 300 MW of generation with transmission system reinforcements within the local transmission system. The need for reactive compensation for this interconnection request will be evaluated in the Impact Study based on the wind turbine manufacturer and type requested by the Customer. Dynamic Stability studies performed as part of the System Impact Study will provide additional guidance as to whether the required reactive compensation can be static or a portion must be dynamic (such as a SVC).

The requirement to interconnect the 300 MW of wind generation on the existing Lawton Eastside (AEPW) – Cimarron (OKGE) 345 kV transmission line consists of adding a new 345 kV three-breaker ring-bus switching station. The new station will be constructed and maintained by OKGE. The Customer did not propose a specific route for the 345 kV line extending to serve its 345/34.5 kV collection facilities. It is assumed that obtaining all necessary right-of-way for the new transmission line to serve its facilities will not be a significant expense.

The total minimum cost for building the required facilities for this 300 MW of generation is \$5,000,000. These costs are shown in Tables 1 and 2. This cost does not include building the 345 kV line from the Customer 345/34.5 kV collector substation into the point of interconnection. This cost also does not include the Customer's 345/34.5 kV collector substation or possible need for reactive compensation. Network constraints in the AEPW, OKGE, Southwestern Public Service Company (SPS), and Western Farmers Electric Cooperative (WFEC) transmission systems that were identified are shown in Table 3. These Network constraints will have to be verified with a Transmission Service Request (TSR) and associated studies. Network Constraints are in the local area of the new generation when this generation is sunk throughout the SPP footprint for the Energy Resource (ER) Interconnection request. With a defined source and sink in a Transmission Service Request, this list of Network Constraints will be refined and expanded to account for all Network Upgrade requirements.

In Table 4, a value of Available Transfer Capability (ATC) associated with each overloaded facility is included. These values may be used by the Customer for future analyses including the determination of lower generation capacity levels that may be installed. When transmission service associated with this interconnection is evaluated, the loading of the facilities listed in this table may be greater due to higher priority reservations. If the loading of a facility is higher, the level of ATC will be lower.

There are several other proposed generation additions in the general area of the Customer's facility. It was assumed in this preliminary analysis that not all of these other projects within the AEPW, OKGE, and WFEC control areas will be in service. Those previously queued projects that have advanced to nearly complete phases were included in this Feasibility Study. In the event that another request for a

generation interconnection with a higher priority withdraws, then this request may have to be re-evaluated to determine the local Network Constraints.

The required interconnection costs listed in Tables 1 and 2 and other upgrades associated with Network Constraints do not include all costs associated with the deliverability of the energy to final customers. These costs are determined by separate studies if the Customer submits a Transmission Service Request through Southwest Power Pool's OASIS.

## Contents

Introduction .....	5
Interconnection Facilities .....	5
Interconnection Estimated Costs .....	6
Powerflow Analysis .....	7
Powerflow Analysis Methodology .....	8
Powerflow Results.....	9
Conclusion .....	11
Appendix A: Point of Interconnection Area Map.....	12

## Tables

Table 1: Direct Assignment Facilities .....	6
Table 2: Required Interconnection Network Upgrade Facilities.....	6
Table 3: Network Constraints.....	9
Table 4: Contingency Analysis .....	10

## Figures

Figure 1: Proposed Method of Interconnection .....	5
Figure 2: Point of Interconnection Area Map .....	12

## Introduction

<OMITTED TEXT> (Customer) has requested a Feasibility Study for the purpose of interconnecting 300 MW of wind generation within the control area of Oklahoma Gas and Electric (OKGE) located in Grady County, Oklahoma. The proposed interconnection point is on the existing Lawton Eastside (American Electric Power West-AEPW) – Cimarron (OKGE) 345 kV transmission line, on the portion owned by OKGE. The proposed in-service date is December 1, 2009


## **Interconnection Facilities**

The primary objective of this study is to identify the system problems associated with connecting the generation to the area transmission system. The Feasibility and other subsequent Interconnection Studies are designed to identify attachment facilities, Network Upgrades and other Direct Assignment Facilities needed to accept power into the grid at the interconnection receipt point.

The requirement to interconnect the 300 MW of wind generation on the existing Lawton Eastside (AEPW) – Cimarron (OKGE) 345 kV transmission line consists of adding a new 345 kV three-breaker ring-bus switching station. The new station will be constructed and maintained by OKGE. The Customer did not propose a specific route for the 345 kV line extending to serve its 345/34.5 kV collection facilities. It is assumed that obtaining all necessary right-of-way for the new transmission line to serve its facilities will not be a significant expense.

Other Network Constraints in the AEPW, OKGE, Southwestern Public Service Company (SPS), and Western Farmers Electric Cooperative (WFEC) transmission systems that were identified are shown in Table 3. With a defined source and sink in a Transmission Service Request (TSR), this list of Network Constraints will be refined and expanded to account for all Network Upgrade requirements.

A preliminary one-line drawing of the interconnection and direct assigned facilities are shown in Figure 1.

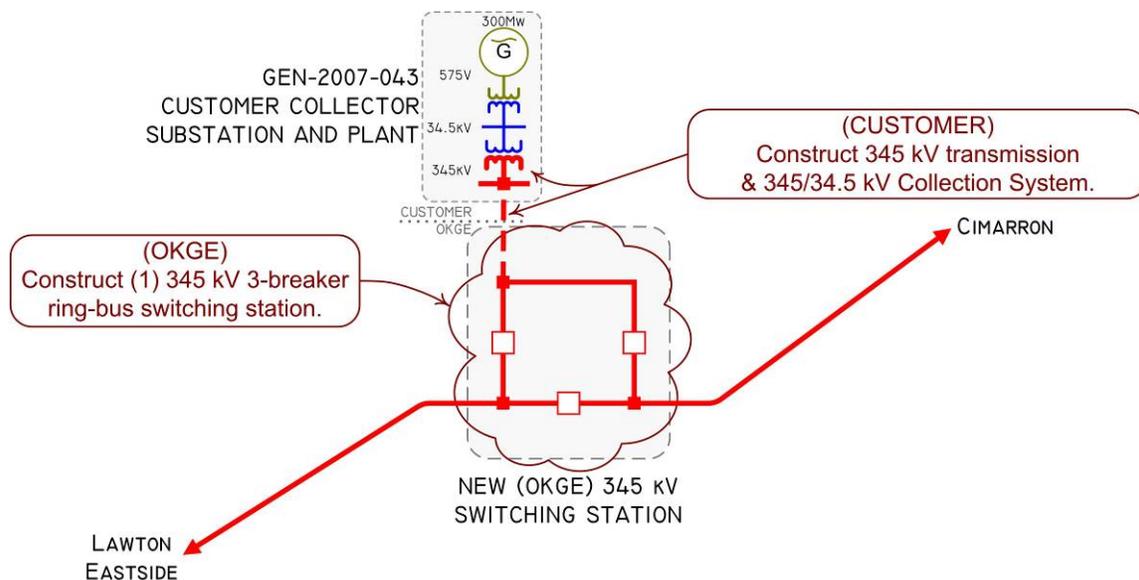

**Figure 1: Proposed Method of Interconnection**

(Final design to be determined)

## Interconnection Estimated Costs

The minimum cost for adding a new 345 kV three-breaker ring-bus switching station serving GEN-2007-043 facilities is estimated at \$5,000,000. These costs are listed in Tables 1 and 2. These estimates will be refined during the development of the System Impact Study based on the final designs. This cost does not include building the Customer's 345 kV transmission line extending from the point of interconnection to serve its 345/34.5 kV collection facilities. This cost also does not include the Customer's 345/34.5 kV collector substation or the possible need for reactive compensation, all of which should be determined by the Customer. The Customer is responsible for these 345 kV – 34.5 kV facilities up to the point of interconnection.

The costs of interconnecting the facility to the SPS transmission system are listed in Table 1 & 2. **These costs do not include any cost that might be associated with short circuit study results or dynamic stability study results.** These costs will be determined when and if a System Impact Study is conducted.

**Table 1: Direct Assignment Facilities**

FACILITY	ESTIMATED COST (2008 DOLLARS)
CUSTOMER – 345/34.5 kV collector substation facilities.	*
CUSTOMER – 345 kV line between Customer collector substation and the new AEPW 345 kV ring-bus switching station.	*
CUSTOMER – Possible reactive compensation to be determined during Impact Study.	*
CUSTOMER – Right-of-Way for all Customer facilities.	*
<b>TOTAL</b>	<b>*</b>

\* Estimates of cost to be determined.

**Table 2: Required Interconnection Network Upgrade Facilities**

FACILITY	ESTIMATED COST (2007 DOLLARS)
OKGE – 345 kV three-breaker ring-bus switching station to be built for generation request #GEN-2007-043 on the Lawton Eastside (AEPW) – Cimarron (OKGE) 345 kV transmission line. Work to include associated switches, control relaying, high speed communications, metering and related equipment, and all related structures.	\$5,000,000
<b>TOTAL</b>	<b>\$5,000,000</b>

\* Estimates of cost to be determined.

## Powerflow Analysis

A powerflow analysis was conducted for the facility using modified versions of the 2009 winter, the 2012 summer and winter peak models and the 2017 summer peak model. The output of the Customer's facility was offset in each model by a reduction in output of existing online SPP generation. This method allows the request to be studied as an Energy Resource (ER) Interconnection request. The proposed in-service date of the generation is December 1, 2009. The available seasonal models used were through the 2017 Summer Peak of which is the end of the current SPP planning horizon.

Following current practice, this analysis was conducted assuming that previous queued requests in the immediate area of this interconnect request were in service. The analysis of the Customer's project indicates that, given the requested generation level of 300 MW and location, additional criteria violations will occur on the existing AEPW, OKGE, SPS, and WFEC transmission systems under steady state and contingency conditions in the peak seasons. Table 3 lists these overloaded facilities.

In Table 4, a value of Available Transfer Capability (ATC) associated with each overloaded facility is included. These values may be used by the Customer to determine lower generation capacity levels that may be installed. When transmission service associated with this interconnection is evaluated, the loading of the facilities listed in this table may be greater due to higher priority reservations. When a facility is overloaded for more than one contingency, only the highest loading on the facility for each season is included in the table.

The need for reactive compensation will be determined during the Impact Study. The need for reactive compensation will be based on the Customer's choice of wind turbine make and manufacturer. Dynamic Stability studies performed as part of the System Impact Study will provide additional guidance as to whether the reactive compensation can be static or a portion must be dynamic (such as a SVC or STATCOM). It is possible that an SVC or STATCOM device will be required at the Customer facility because of FERC Order 661A Low Voltage Ride-Through Provisions (LVRT) which went into effect January 1, 2006. FERC Order 661A orders that wind farms stay on-line for 3-phase faults at the point of interconnection even if that requires the installation of a SVC or STATCOM device.

There are several other proposed generation additions in the general area of the Customer's facility. Some of the local projects that were previously queued were assumed to be in service in this Feasibility Study. Not all local projects that were previously queued and have advanced to nearly complete phases were included in this Feasibility Study.

## **Powerflow Analysis Methodology**

The Southwest Power Pool (SPP) criteria states that: “The transmission system of the SPP region shall be planned and constructed so that the contingencies as set forth in the Criteria will meet the applicable NERC Planning Standards for System Adequacy and Security – Transmission System Table I hereafter referred to as NERC Table I) and its applicable standards and measurements”.

Using the created models and the ACCC function of PSS/E, single contingencies in portions or all of the modeled control areas of Sunflower Electric Power Corporation (SUNC), Missouri Public Service (MIPU), Westar Energy (WERE), Kansas City Power & Light (KCPL), West Plains (WEPL), Midwest Energy (MIDW), Oklahoma Gas and Electric (OKGE), American Electric Power West (AEPW), Grand River Dam Authority (GRDA), Southwestern Public Service Company (SPS), Western Farmers Electric Cooperative (WFEC) and other control areas were applied and the resulting scenarios analyzed. This satisfies the ‘more probable’ contingency testing criteria mandated by NERC and the SPP criteria.

## Powerflow Results

**Table 3: Network Constraints**

<b>AREA</b>	<b>OVERLOADED ELEMENT</b>
AEPW/SPS	2006-02T 230.00 - GRAPEVINE INTERCHANGE 230KV CKT 1
AEPW/WFEC	ELK CITY - CLINTON JUNCTION 138KV CKT 1
OKGE	CIMARRON - HAYMAKER 138KV CKT 1
OKGE	DIVISION AVE - HAYMAKER 138KV CKT 1
AEPW	American Electric Power West
OKGE	Oklahoma Gas and Electric
SPS	Southwest Public Service Company
WFEC	Western Farmers

**Table 4: Contingency Analysis**

SEASON	OVERLOADED ELEMENT	RATING (MVA)	LOADING (%)	ATC (MW)	CONTINGENCY
09WP	DIVISION AVE - HAYMAKER 138KV CKT 1	308	107	0	CIMARRON - CZECH HALL 138KV CKT 1
12SP	2006-02T 230.00 - GRAPEVINE INTERCHANGE 230KV CKT 1	351	131	0	OKLAUNION - TUCO INTERCHANGE 345KV CKT 1
12SP	CIMARRON - HAYMAKER 138KV CKT 1	308	114	0	CIMARRON - CZECH HALL 138KV CKT 1
12SP	DIVISION AVE - HAYMAKER 138KV CKT 1	308	110	0	CIMARRON - CZECH HALL 138KV CKT 1
12WP	DIVISION AVE - HAYMAKER 138KV CKT 1	308	119	0	CIMARRON - CZECH HALL 138KV CKT 1
12WP	CIMARRON - HAYMAKER 138KV CKT 1	375	101	239	CIMARRON - CZECH HALL 138KV CKT 1
17SP	2006-02T 230.00 - GRAPEVINE INTERCHANGE 230KV CKT 1	351	132	0	OKLAUNION - TUCO INTERCHANGE 345KV CKT 1
17SP	CIMARRON - HAYMAKER 138KV CKT 1	308	113	0	CIMARRON - CZECH HALL 138KV CKT 1
17SP	DIVISION AVE - HAYMAKER 138KV CKT 1	308	108	0	CIMARRON - CZECH HALL 138KV CKT 1
17SP	ELK CITY - CLINTON JUNCTION 138KV CKT 1	143	104	127	OKLAUNION - TUCO INTERCHANGE 345KV CKT 1

*Note: When transmission service associated with this interconnection is evaluated, the loading of the facilities listed in this Table may be greater due to higher priority reservations. If the loading of a facility is higher, the level of ATC will be lower.*

## **Conclusion**

The minimum cost of interconnecting the Customer's interconnection request is estimated at \$5,000,000 for Direct Assignment Facilities and Network Upgrades. At this time, the cost estimates for other Direct Assignment facilities including those in Tables 1 and 2 have not been defined by the Customer. In addition to the Customer's proposed interconnection facilities, the Customer may be responsible for installing reactive compensation in the Customer's substation. The need for reactive compensation will be determined by the Impact Study should the Customer choose to sign an Impact Study Agreement. As stated earlier, some but not all of the local projects that were previously queued are assumed to be in service in this Feasibility Study. These costs exclude upgrades of other transmission facilities that were listed in Table 3 of which are Network Constraints.

In Table 4, a value of Available Transfer Capability (ATC) associated with each overloaded facility is included. These values may be used by the Customer to determine lower generation capacity levels that may be installed. When transmission service associated with this interconnection is evaluated, the loading of the facilities listed in this table may be greater due to higher priority reservations. When a facility is overloaded for more than one contingency, only the highest loading on the facility for each season is included in the table.

These interconnection costs do not include any cost that may be associated with short circuit or transient stability analysis. These studies will be performed if the Customer signs a System Impact Study Agreement. At the time of the System Impact Study, a better determination of the interconnection facilities may be available.

The required interconnection costs listed in Tables 1 and 2 and other upgrades associated with Network Constraints do not include all costs associated with the deliverability of the energy to final customers. These costs are determined by separate studies if the Customer submits a Transmission Service Request through Southwest Power Pool's OASIS.

